



GASOLINE SERVICE STATION EQUIPMENT

J


Vapor Recovery Option 2
 Fill/Vapor return: remote
 Tank venting: manifolded below ground
 Stage II return: manifolded



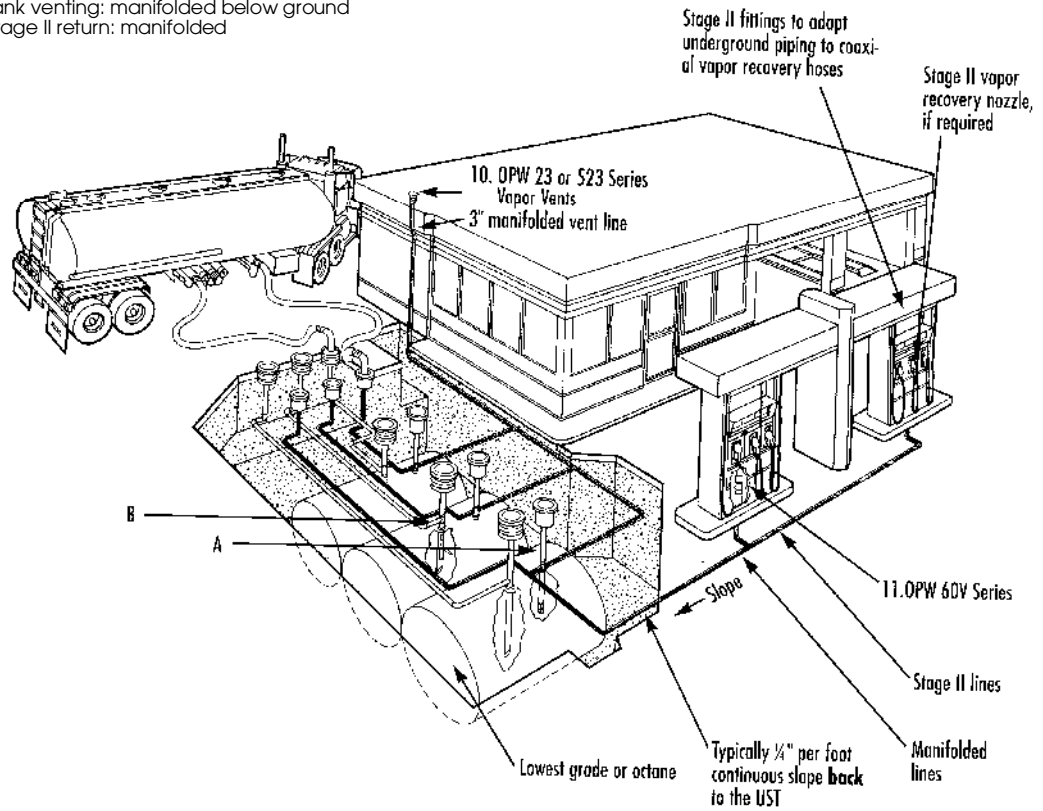





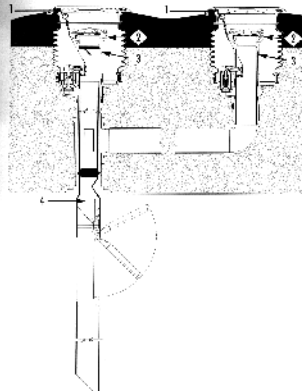



A. Overfill Prevention with the OPW 53VM



B. Overfill Prevention with OPW 61SOR



- | | | |
|---|---|---|
|  |  |  |
| 1. OPW 12100 Series | 5. OPW 104A, Model | 8. OPW 233V or 233VM Extractor Fitting |
|  |  |  |
| 2. OPW 61SET Cap | 6. OPW 101LT | 9. OPW 53 Series or 30MV Series |
|  |  |  |
| 3. OPW 61SE Adaptor | 7. OPW 1011AV Adaptor | 10. OPW 23 or 523 Series |
| | |  |
| | | 11. OPW 60V Series |

